


### STRUKTURA SYSTEMU

**Legenda:**  
— ETHERNET  
— CPU DIRECT (RS422, GT01-C034R-8P)  
— RS485 (MODBUS RTU)  
— CC-LINK

Vijeo Citect V7.50 Service Pack 1 Patch 34 ZEC\_KOZIENICE\_23\_09\_2020\_v75sp1p34lan V7.50.7900 Jan 20 2017

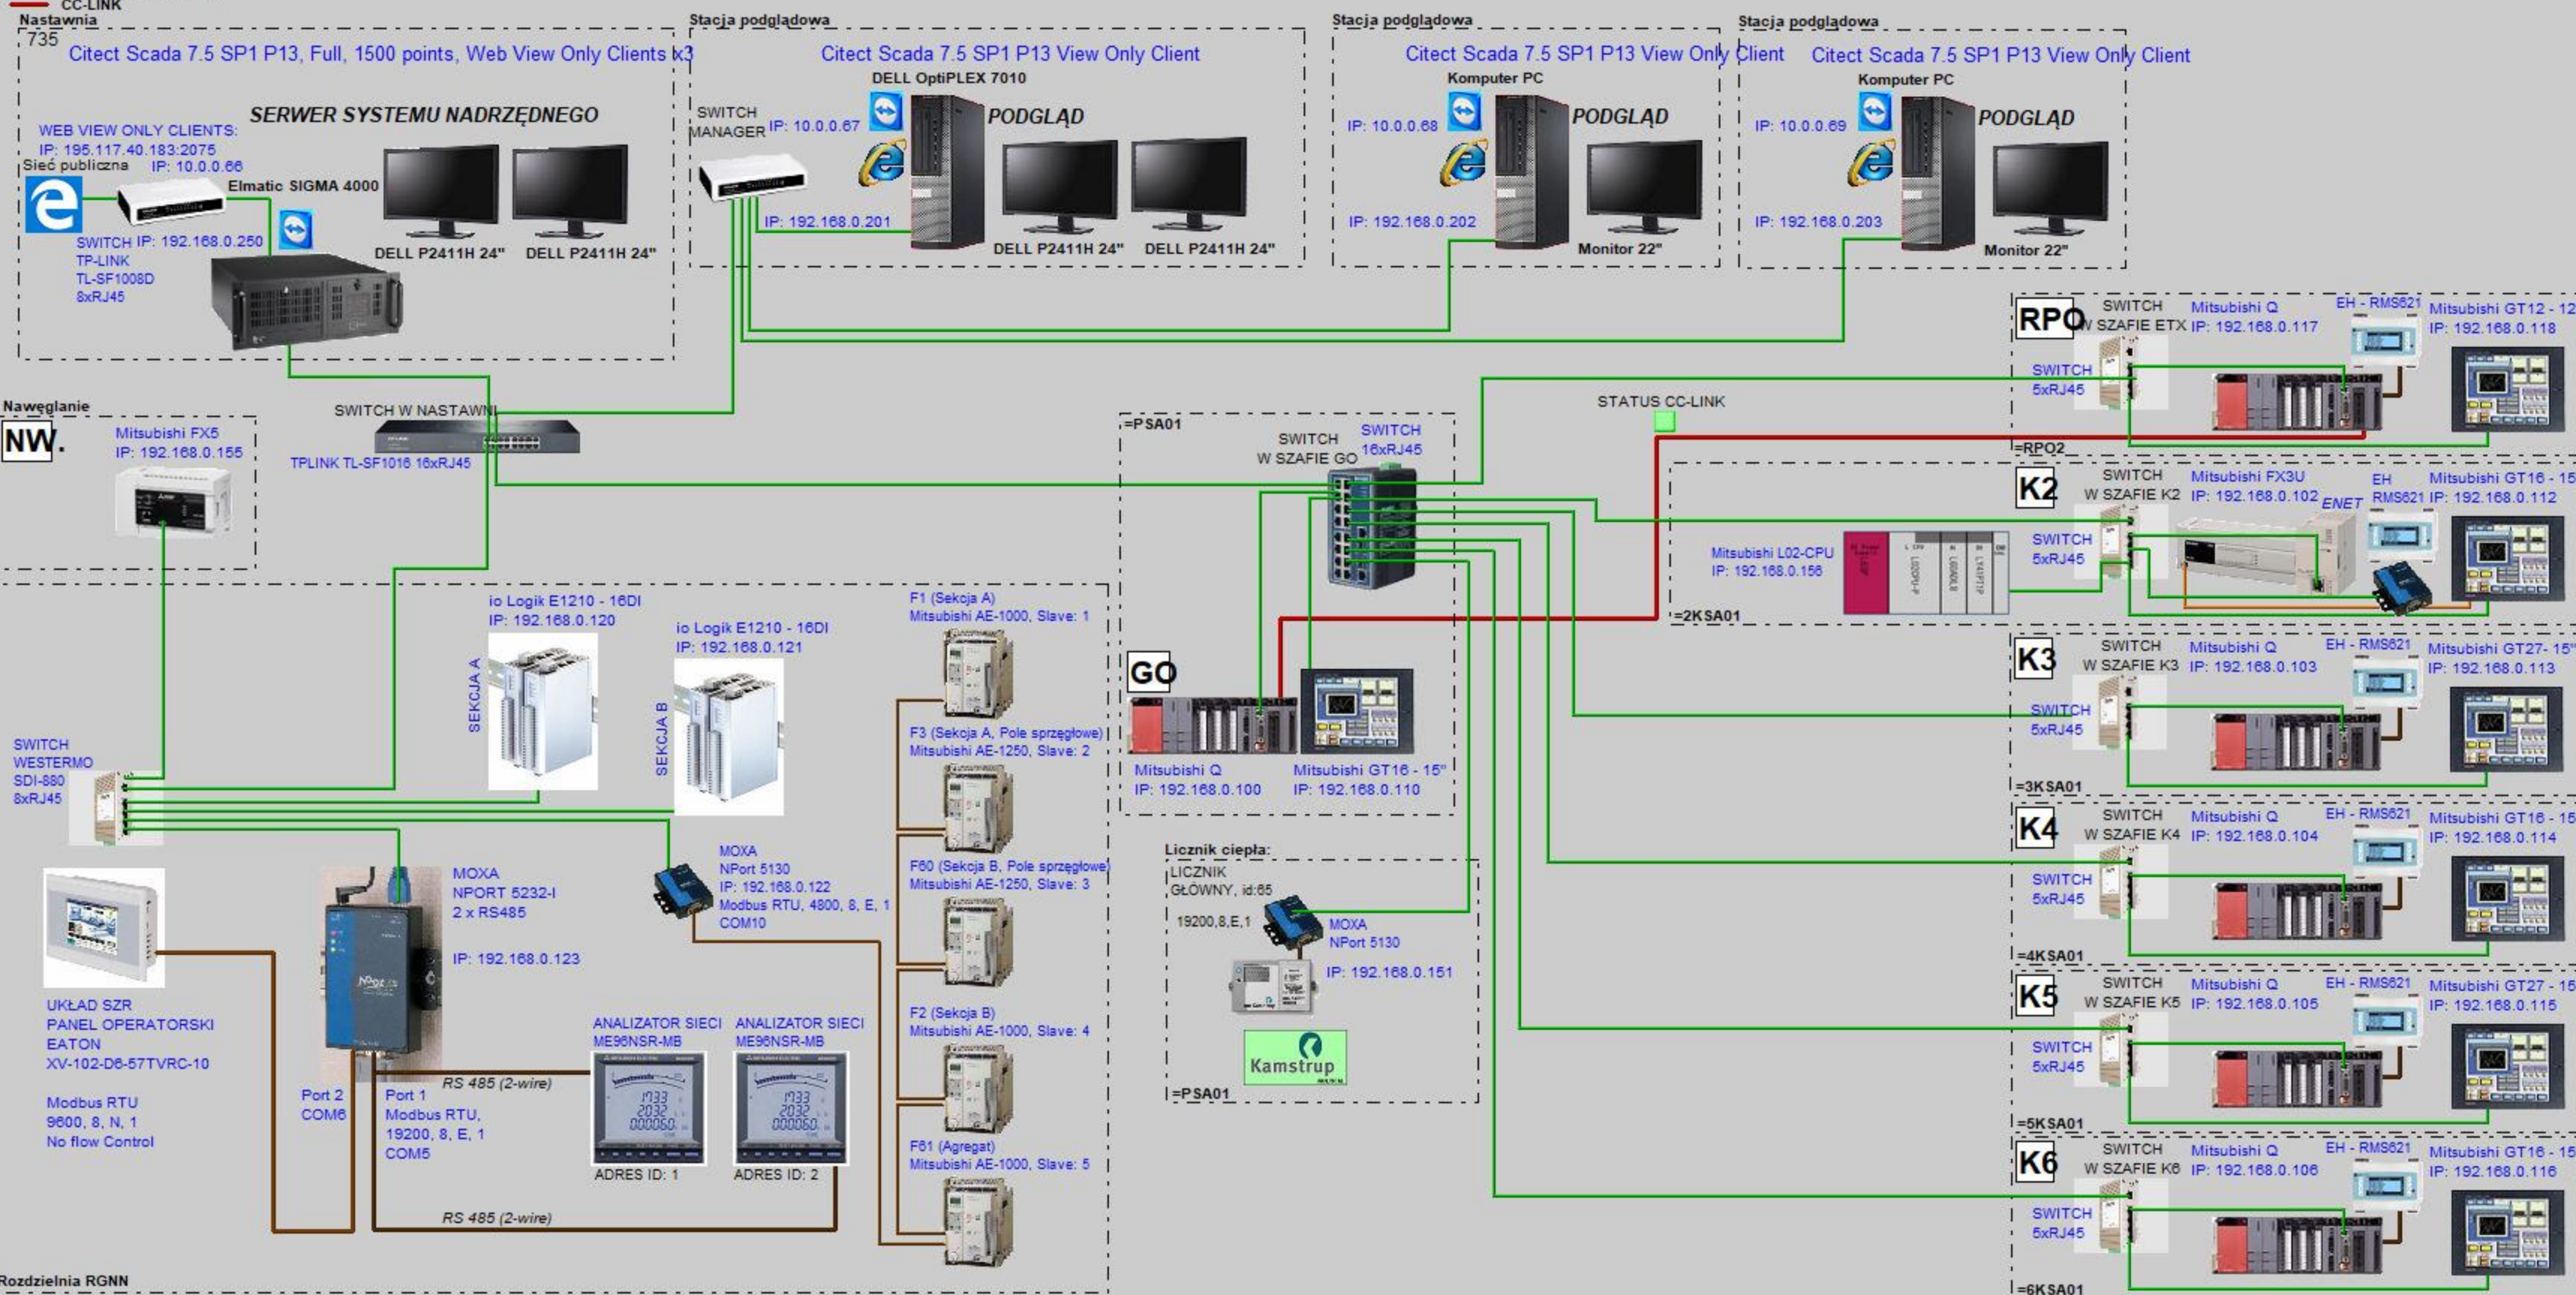

Urządzenia IO	Status
KOCIOŁ K2 (L02)	Running
KOCIOŁ K2 (FX)	Running
KOCIOŁ K3 (Q)	Running
KOCIOŁ K4 (Q)	Running
KOCIOŁ K5 (Q)	Running
KOCIOŁ K6 (Q)	Running
GO RPO2 (Q)	Running
GO ZPSA (Q)	Running
U1 - MOXA	Running
U2 - MOXA	Running
MOXA E1210 IO	Running
MOXA E1210 IO	Running
SZR	Running
KAMSTRUP	Running
Disk IO (GO,RPO,SZR)	Running
Disk IO (K2)	Running
Disk IO (K3)	Running
Disk IO (K4)	Running
Disk IO (K5)	Running
Disk IO (K6)	Running

**Rozdzielnia RGNN**  
 13:47:12 2023-01-20 K6 - PRZENOŚNIKI - BRAK GOT. ELEKTR ON  
 07:51:16 2023-01-20 K6 - KLAPA NR2 NA KANAŁE SPALIN - NIE OTWARTA ON  
 00:02:31 2023-01-20 K2 - AWARIA W TORZE BŁOKAD ON